




SECUREDGE 2000 STANDARD FASCIA

FULLY ADHERED OR MECHANICALLY ATTACHED SINGLE-PLY VERSION

NOTES

- For non-90 miters, see separate print approval
- Product should be installed per provided installation instructions
- ANSI/SPRI/FM 4435/ES-1 Test Pressure up to 275 psf.

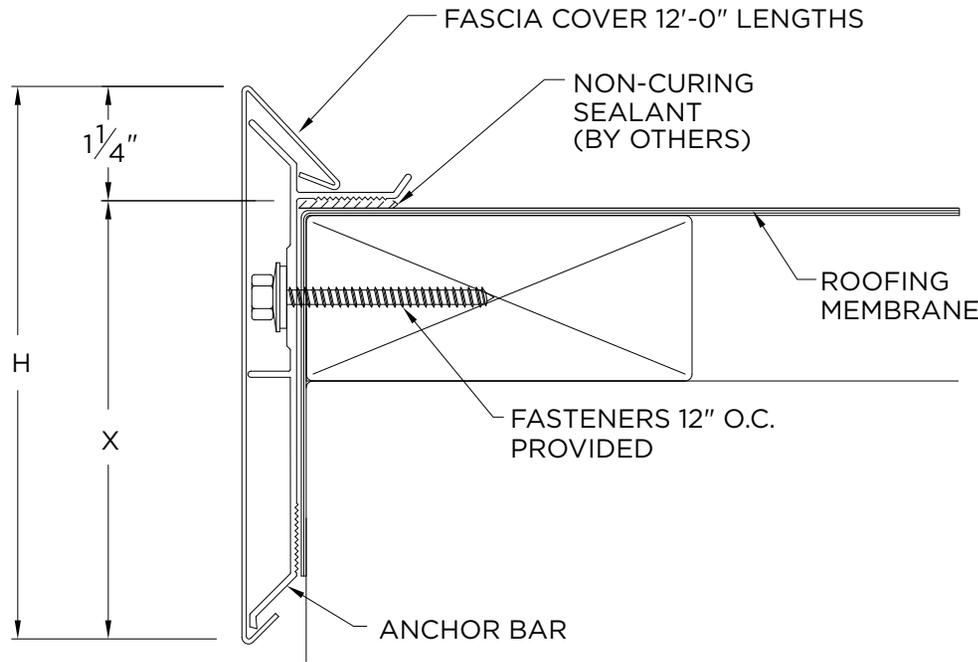

APPROVALS



ANSI/SPRI/FM 4435/ES-1
Test Pressures listed in notes

PROJECT INFO

Project Name: _____

Architect: _____

Roofing Contractor: _____

Project Type:

By selecting this box you have verified and confirmed that dimensions, sizes, and quantities are correct. All products will be installed in strict accordance with printed instructions.

Date: _____

CKD BY: **MM**

DWG #: 15010-1596

REV: **H**

DIMENSIONS

PRODUCT ID. NO.	H DIM	X DIM	NAILER COVERAGE
<input type="checkbox"/> AF-40	4"	2 3/4"	1 NAILER
<input type="checkbox"/> AF-55	5 1/2"	4 1/4"	2 NAILERS
<input type="checkbox"/> AF-70	7"	5 3/4"	3 NAILERS
<input type="checkbox"/> AF-85	8 1/2"	7 1/4"	4 NAILERS

MATERIAL

- 24 Ga. Galv. Steel Color: _____
- 22 Ga. Galv. Steel Finish: _____
- .040" Aluminum
- Substrate:** Wood
- If substrate is not given, wood fasteners will be provided. Masonry
- Metal
- OTHER: _____

QUANTITIES

- | | | |
|------------------------------------|------------------------------|---|
| _____ Lineal Feet (12'-0" Lengths) | _____ Right Endwall Flashing | _____ Overflow Scupper |
| _____ Outside Miter (90°) | _____ Left Endwall Flashing | <input type="checkbox"/> Style A |
| _____ Inside Miter (90°) | | <input type="checkbox"/> Style B |
| _____ Right Endcaps | | _____ Spillout Scupper |
| _____ Left Endcaps | | <input type="checkbox"/> Style A |
| | | <input type="checkbox"/> Style B |
| | | _____ Downspout Scupper |
| | | <input type="checkbox"/> Style A <input type="checkbox"/> Style B |
| | | Size _____x_____ |
| | | Style A=Tapered 1.5" Drop Style B=Flat |