




VERSITRIM 2000 STANDARD FASCIA

FULLY ADHERED OR MECHANICALLY ATTACHED SINGLE-PLY VERSION

NOTES

- For non-90 miters, see separate print approval
- Product should be installed per provided installation instructions
- ANSI/SPRI/FM 4435/ES-1 Test Pressure up to 275 psf.

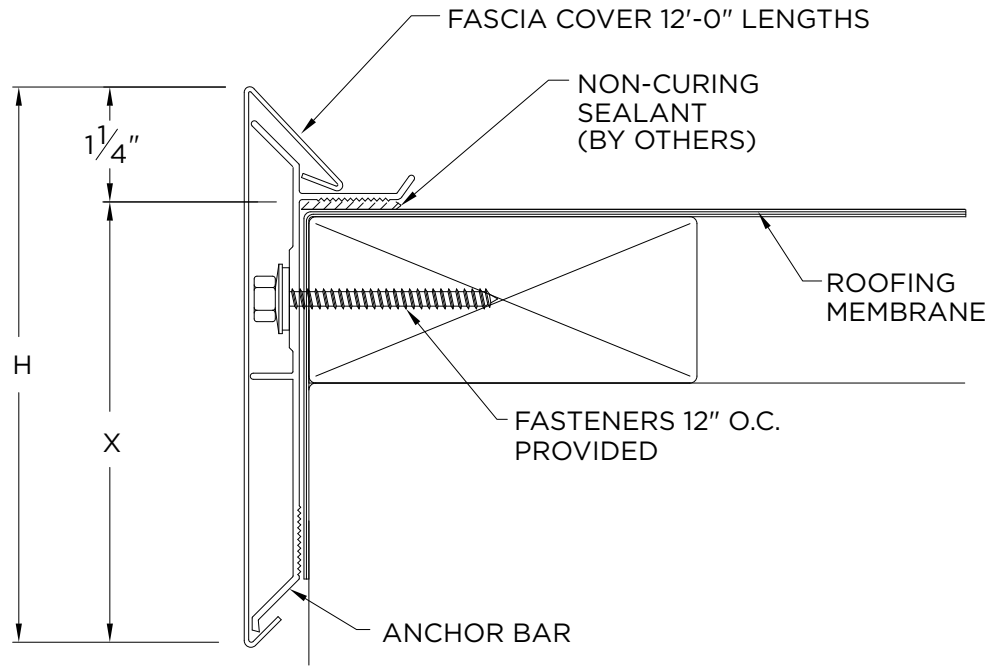

APPROVALS



ANSI/SPRI/FM 4435/ES-1
Test Pressures listed in notes

PROJECT INFO

Project Name: _____

Architect: _____

Roofing Contractor: _____

Project Type: _____

☐ By selecting this box you have verified and confirmed that dimensions, sizes, and quantities are correct. All products will be installed in strict accordance with printed instructions.

Date: _____

Versico

Customer Service
800-558-2162
(Metal-Era)

SHT# 1 of 1

DATE: 11/29/21

DRN BY: JJC

CKD BY: MM

DWG #: 18010-1988

REV: I

DIMENSIONS

PRODUCT ID. NO.	H DIM	X DIM	NAILER COVERAGE
☐ AF-40	4"	2 3/4"	1 NAILER
☐ AF-55	5 1/2"	4 1/4"	2 NAILERS
☐ AF-70	7"	5 3/4"	3 NAILERS
☐ AF-85	8 1/2"	7 1/4"	4 NAILERS

MATERIAL

- ☐ 24 Ga. Galv. Steel
☐ 22 Ga. Galv. Steel
☐ .040" Aluminum

Color: _____

Finish: _____

Substrate: ☐ Wood

If substrate is not given, wood fasteners will be provided.

☐ Masonry

☐ Metal

☐ OTHER: _____

QUANTITIES

_____ Lineal Feet (12'-0" Lengths)

_____ Outside Miter (90°)

_____ Inside Miter (90°)

_____ Right Endcaps

_____ Left Endcaps

_____ Right Endwall Flashing

_____ Left Endwall Flashing

_____ Overflow Scupper

☐ Style A

☐ Style B

_____ Spillout Scupper

☐ Style A

☐ Style B

_____ Downspout Scupper

☐ Style A ☐ Style B

Size _____x_____

Style A=Tapered 1.5" Drop | Style B=Flat